


CITY WATER INSTALLATION CONFIGURATION



PLANET FRIENDLY™

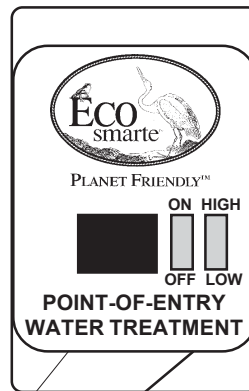

ECOsmarte Point-of-Entry

110V

Power Settings:

HIGH: Low TDS Waters
(below 500ppm)

LOW: Medium to High TDS Waters
(above 500 ppm)

**Flowswitch
(thinner
wire)**

Lights will
circle on
control box,
indicating
power to the
electrodes,
when faucet
is opened.

To Home

**Thicker wire
to chamber**

**2510
Control Head**

Jumper Wire

DUAL ELECTRODES

Copper Ionization

Titanium Oxidation

Natural Oxygen

From
City
Line

Freeboard

(30% of Tank)

Granular Activated Carbon

(to be installed last, premeasured
chemical removal media)

Hydroxite™

Measured Mineral Media
(optional - based on city water
source)

Sterile Pea Rock

Installs first, premeasured.
Larger stones toward bottom.

***An Alternative
Science to
Water Softening
and
Reverse Osmosis...***

EPA EST#68770-CA-001

1-800-466-7946



PLANET FRIENDLY™

ECOsmarte™ Point-of-Entry Municipal System Pre-Install Checklist

Your Point-of-Entry Municipal System will require the following material and tools for proper installation:

Tools & Working Items

- ☐ Only PVC Cement & Cleaner (No CPVC or ABS)
- ☐ 2" Pipe Wrench & 18" Water Pump Pliers
- ☐ Pipe Cutter (Copper) or Hacksaw & Sandpaper (Cleaning end of pipe)
- ☐ Propane Torch, Flux, Lead-free Solder for copper required plumbing
- ☐ Screwdriver (Med. Flat), Needle Nose Pliers, Funnel, & consumables (screws, teflon tape, pipe straps)
- ☐ Access to Floor Drain or Laundry Tub Drain, Backwash Drain Hose (5/8" OD, 1/2" ID), Measure Distance from tank to drain, (3/8" ID) Hose Clamp for valve, mounting clamp for drain
- ☐ 110V Duplex Outlet within 4 feet of electronics and 6 feet from filter tank
- ☐ 10' Roll Plastic Plumbers Tape
- ☐ Two 3/4", 1" or 1 1/4" PVC Bushings to reduce ECOsmarte™ electrode chamber at unions (1 1/2") to your pipesize
- ☐ Check valve (if your Point-Of-Entry installs within 20 pipefeet of water heater)
- ☐ Three (3) Ball Valves or Shut-Offs

You should have received the following:

- ☐ 1 NSF rated ECOsmarte™ 2510 filter control valve (to install on filter w/ clip on upper basket)
- ☐ 1 NSF Filter Media Tank
- ☐ 1 Distributor Tube (Pre-installed in filter, with lower basket installed)
- ☐ 1 NSF Sterile Pea Rock (premeasured)
- ☐ 1 Flow Switch, 1" FPT with electronics (**must be installed vertically**)
- ☐ 1 Copper / Titanium Electrode Chamber, 1 1/2" Hub with NSF rated slip union.
- ☐ 1 Flow Switch, 1" FPT
- ☐ 1 Copper / Titanium Electrode Chamber, 1 1/2 Hub with 3/4" or 1" PVC reducing bushing
- ☐ 1 ECOsmarte™ Point-of-Entry Electronic System
- ☐ 1 Warranty Card with Electrode Referral Offer within this document
- ☐ 1 Installation / Operating Guide (this document)

Optional Items

- ☐ ECOsmarte™ Planet Friendly Hydroxite™ (if municipal iron level is above 0.6 ppm)
- ☐ ECOsmarte 2510 Water Miser Valve Upgrade (metered)

EPA EST #68770-CA-001

INSTALLING THE ECOSMARTE MUNICIPAL POINT-OF-ENTRY SYSTEM:

Congratulations on your new investment! The ECOsmarte Municipal Point-of-Entry Water System will provide years of satisfying home water.

The Point-of-Entry is designed to neutralize the harmful effects of hard minerals by ionization; and, at the same time, remove chlorine, foul taste and odors, sulfur, iron, dirt, rust, toxic chemicals and physical contaminants from your water system. It contains an electronic ionization chamber, high quality activated carbon, and a special blend of natural minerals to provide you with “filtered spring water” at every tap in your home or place of business.

When properly installed, the Point-of-Entry will provide many years of trouble-free service. Read this manual carefully and follow the installation steps in proper order.

Ionic Water Purification

“Ionic Water Purification” is an effective and proven method in preventing scale and controlling corrosion, in most applications Ionization is effective in removing existing scale buildup on pipes, plumbing and mechanical equipment. Electronic oxidation will provide additional oxygen to improve municipally fed water. Ionic water purification removes toxic chemicals from water and has benefits and features that allow it to go beyond water conditioning to become a complete water purification system. You have purchased the best non- salt, non-chemical technology available.

Bacteria

When bacteria is a concern, testing can be done at a cost of less than a few dollars by using a simple milipore bacteria test kit. Ionization controls biological infestations. The Point-of-Entry Systems are designed to provide bacteria control to protect the filter media from transient bacteria infestation. When known bacteria contamination exists in the source water, specific design and equipment must be used to assure adequate protection. Both of your electrode pairs have bacterial kill rates, but known bacteria in water should be EPA/ETL lab tested. The low-level ionization in your piping will provide longer and better protection against bacteria than your previously chlorinated water, when water is standing in the line.

Toxic Chemicals

When toxic chemicals, herbicides, pesticides, fertilizers or septic contaminants are known or suspected in the water, specific and proper sized equipment is required. The tank size 10x54 furnished is designed to provide 99.9% removal of chlorine and volatile organic chemical.

ECOsmarte has oversized your equipment for residential protection levels. You have protection against future chemicals in the municipal water supply.

Description and Operation

The Point-of-Entry consists of two major components:

1. Electronic Ionization and Oxidation System including Electrode Chambers: The Ionization System provides a low voltage electrical charge creating positively charged mineral ions, which significantly alters the physical characteristics of the water, minerals and chemicals in the water. Some dissolved substances become filterable, others are rendered neutral and will stay in solution providing benefits to health and superior taste. Your oxygen electrodes will oxidize mineral and bacteria, while raising the level of dissolved oxygen in the water.
2. Self cleaning filter with: Granular Activated Carbon (GAC) and sterile pea gravel, a special blend of insoluble natural minerals to filter and remove contaminants. The high quality filtration virtually provides, “Filtered Spring Water.” Healthy beneficial calcium remains in your water in soluble, bicarbonate form.

The Municipal System has Two Options

1. Upflow non-backwashing for municipal treated water. (Requires 3 - 5 year media replacement.)
2. Automatic backwash, an important feature that keeps the filter clean for years under normal conditions. The automatic “Backwash” on The Point-of- Entry can be set to operate daily or only on pre-selected days up to once every 10 days.

All Point-of-Entry systems have been over-designed to allow for irregularities of water flow and contaminant levels. Each system has a recommended maximum level of water flow per minute and is related to the Maximum Contaminant Removal.

Granulated Activated Carbon (GAC)

Activated Carbon is very effective in removing these hazardous chemicals and is further supported with Hydroxite. The Point-of-Entry is specially designed to permit a “normal” rate of water flow, to allow enough contact time for efficient removal of toxic contaminants. Your Ecosmarte system contains only the best GAC.

Point-of-Entry Installation Guide - Municipal Water

FLOW RATES

The Point-of-Entry System requires proper water service flow rates for satisfactory performance. Water flow rates of less than 10 gpm through the Point-of-Entry System will not allow proper backwash of the filter bed. A larger pump or booster pump may be required.

If the media is not properly back-washed it will not break loose the contaminants. Without proper backwash the bed will slowly foul and make the media useless.

TANK SIZE

The recommended size value and tank will determine the satisfactory performance or failure of the system. Water volume or flow rate requires commercial equipment. For customers that demand calcium removal, a water softener can be used along with the Point-of-Entry system, with the softener first in-line. If system is configured with a softener, be sure not to backwash filter and softener at the same time. We advise an under-sink reverse osmosis system (non-brine) for complete calcium and sodium removal in drinking water.

INSPECTING AND HANDLING THE SYSTEM

Inspect the equipment for any visible shipping damage. If damaged, notify the transportation company and request a damage inspection. Damage to cartons should also be noted.

NOTES:

Handle the filter unit with care. Damage can result if dropped or if set on sharp, uneven projections on the floor. Do not turn the filter unit upside down.

If a severe loss in water pressure is observed when the filter unit is initially placed in service, the filter tank may have been laid on its side during transit. If this occurs, backwash the filter to "reclassify" the media. The sand or gravel will resettle to bottom after several back-washings.

PLANNING

1. All installation procedures **MUST** conform to local and state plumbing codes.
2. Remember that the **FILTER INLET** is marked with arrows. This is connected to the main water supply (i.e., from the water pump or the water meter).

3. Before installation study the existing piping system and determine the type of fittings required. **NOTE:** If the plumbing system is used to ground the electric supply, continuity should be by installing ground swaps around any nonconductive plastic piping used in this installation. It's highly recommended to use an alternative grounding source other than the water supply.

FILTER LOCATION

1. Select the location of your filter tank with care. The installation of the Point-of-Entry should allow for easy access to the main water supply, to allow for treatment of all water at the location.
2. An accessible drain to backwash the system is required. Since the tank will rinse itself. .
3. Do not install a filter in a location where freezing temperatures occur. Freezing may cause permanent damage to this type of equipment, and will void the factory warranty. .
4. Temperatures above 120°F may also damage filters and will void the factory warranty. Garage installation in desert climates is okay as long as direct sun light is avoided.
5. **IMPORTANT:** If installed within 20 running pipe feet of your water heater, a check valve to prevent suction of hot water back into your filter is required.

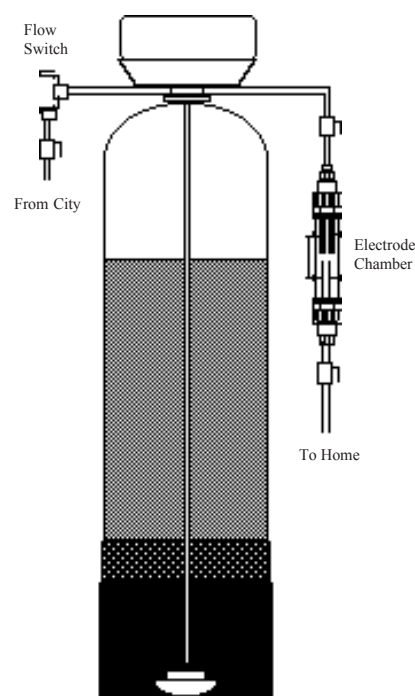


Fig. 1: Free Space to allow for proper backwashing; Anchor 1/2" drain hose from water valve to drain.

Point-of-Entry Installation Guide - Municipal Water

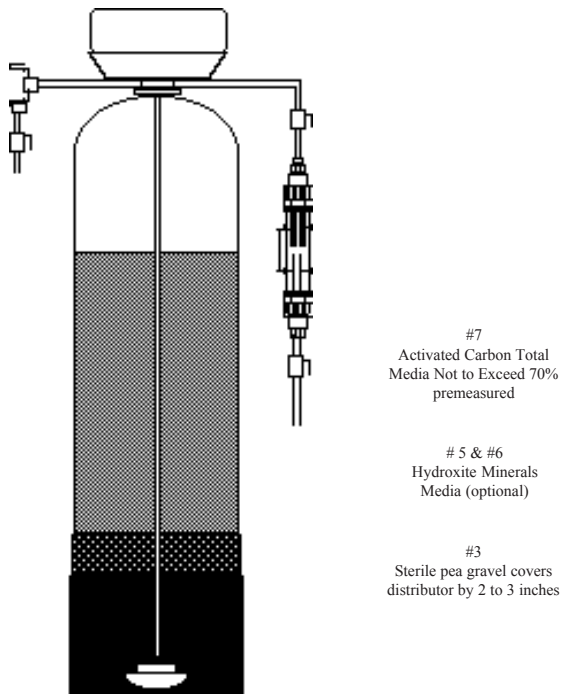


Fig. 2: Use all media in your premeasured ECOsmarte packaging.

FILTER TANK FILLING

For ease of handling and installation it is sometimes preferable to load and fill tanks at the location. These are procedures to follow:

1. Tape top of distributor tube, to prevent media from entering. If media gets into the distributor tube it will plug up the backwash valve causing poor or no water to flow.
2. Center distributor tube with a 1/4 to 1/2-inch extension above the top of the tank.
3. With optional fill funnel hold tube centered and install clean and washed coarse gravel. This should cover the base of the distributor tube by 2 to 3 inches minimum. (Pre-measured)
4. Check to make sure that the tape at the top of the distributor tube is not damaged.
5. Option: Additional coarse sand or Filter-ag. Up to an additional 2 gallons of coarse sand can be added to improve clarity and filtration for waters that have high turbidity caused by silt or other particles in the water. This is unique to certain areas North America
6. Option: Additional Hydroxite for iron and odor removal for rural well water installations if required, or in municipal water systems not meeting federal guidelines. your City System without Hydroxite should remove 0.6 ppm iron at 7.0 pH or above, the EPA permitted maximum, without Hydroxite.

7. Add activated carbon. Caution should be used as the fine dust easily gets all over. Recommended: use mask when filling, your packaging has been pre-measured for volume.
8. After adding media clean top of the tanks and threads, making sure all particulate is wiped clear.
9. Check and remove tape and clean the top of the distributor tube.
10. Move tank close to the area of installation and fill with water. Should sit for twenty-four hours to let the media settle and escape. Air trapped in the filter can force small amounts of carbon into the water supply at start-up of system.

INSTALLATION OF 2510 CONTROL HEAD

1. After positioning tank, lubricate the distributor tube o-ring seal and tank o-ring seal. The 1" distributor tube should be cut flush with the top of each tank.
2. Place the main control valve on tank. Note: Only use silicon lubricant
3. Keep timer head straight when screwing on tank, as this will pull the distributor tube through the o-ring.
4. Place 2510 Control in by-pass position. Turn on main water supply. Open a cold water tap nearby and let run a few minutes or clear. Close water tap.
5. Place 2510 Control in service position and let water flow into the tanks. When water flow stops, slowly open a cold water tap nearby and let run until air is purged from unit.
6. Plug unit into an electrical outlet and set timer.
7. The in-service dial (with faceplate removed) will rotate for one hour and forty-five minutes, but the entire backwash cycle is completed in approximately the first fifteen minutes.
8. Recommended backwash interval is once every ten days.

***The Best Non-Salt, Non-Chemical
Water Technology...***

Point-of-Entry Installation Guide - Municipal Water



PLANET FRIENDLY™

FILTER TANK INSTALLATION SET-UP

1. Position your filled tank where it will be permanently located.
2. Take measurements for plumbing configuration, and actual length of drain hose required.
3. The bypass valve can be separated from the valve body by removing the two screws and “u” clips, to allow the tank to be pulled out for easier installation.
4. Either PVC or copper pipe and fittings should be used and precut and fitted,
5. Unions and shut-offs should be considered to allow bypass and servicing of equipment.
6. Shut off main water supply and install.

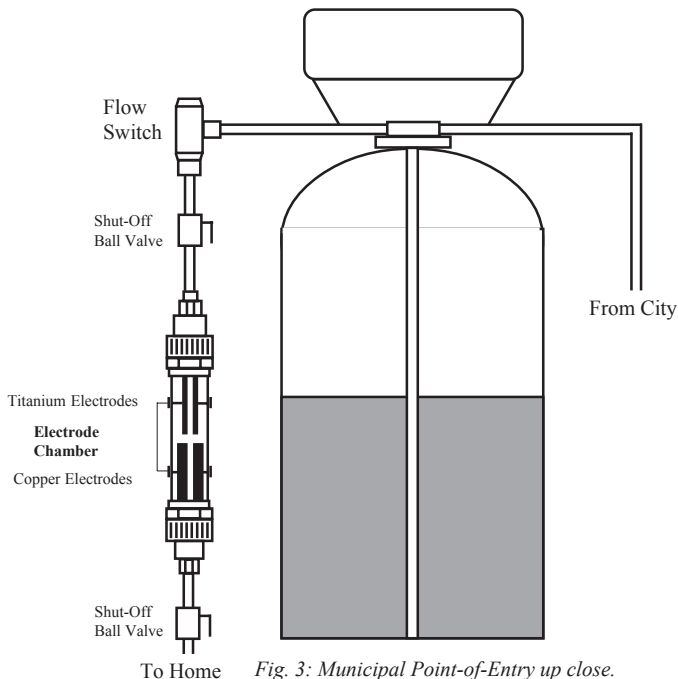


Fig. 3: Municipal Point-of-Entry up close.

NEW CONSTRUCTION ONLY

Chlorinated municipal water should run through each faucet, hot and cold to accelerate removal of dust and oxidize solder residues. It is not unusual to see debris in your water for 7 - 21 days. Run faucet 5 seconds before drinking.

ELECTRONIC INSTALLATION

1. 2510 Control and ECOsmarte Point-of-Entry control box may plug into the same outlet; they both 110V.
2. The thin clear wires from the Point-of-Entry control box and the wires from the flow switch must be connected to activate the system when water flows. The flow switch is designed to regulate current from the control box to your electrodes.
3. The thick wires (white) from the ECOsmarte control box connect to the titanium electrode chamber. The voltage Power wire from the ECOsmarte control box is a double wire and can be split and cut and fit as desired. The thinner, low-voltage wire connects to the flow switch. Connect your 10' jumper wire from the titanium to copper chamber.
4. There is a circle of red lights on the control box. The flow switch activates the circling lights. Approximately every 4 to 5 minutes the lights will reverse direction. The change in direction indicates a polarity reversal that induces self cleaning of the electrodes. The lights must be on to indicate the system is operating. A light circles when a faucet is opened. A single light indicates power available to the system.

START-UP


1. Before allowing the water to flow through the Point-of-Entry system, the bypass valve on the back of the water valve should be in the “BY-PASS” position.
2. Turn main water supply on. Check fittings and installation for any leaks. Run water in each faucet, flush toilets to remove air from lines.
3. Turn off your hot water Inlet valve before beginning your first backwash.
4. Manually backwash the system by turning the timer head. **Do not open a faucet until the backwash is complete and runs clear water.** Using the faucet nearest the unit, open and run until clear.
5. Turn on a faucet nearest the Point-of-Entry system. This will allow water to flow through the Point-of-Entry system when the valve is in service. This will minimize air bubbles and activated carbon in the pipes.
6. From the nearest faucet, run the hot water until clear. If nearest faucet is “down-line” from water heater, drain hot water heater, and flush with hose level pressure.

Point-of-Entry Installation Guide - Municipal Water



2510 CONTROL HEAD START-UP INSTRUCTIONS

1. Remove control box cover.
2. Make "Time of Day" setting and set "Program Wheel". (See "Timer Program" instructions). Rotate program wheel counter-clockwise until it stops at regeneration position.
3. To set the control valve positions, turn the manual regeneration knob slowly in a clockwise direction until the "Program Micro Switch" lifts on top of the first set of pins. Allow the drive motor to move the piston to the first regeneration step and stop. Each time the Program Switch position changes, the valve will advance to the next regeneration step. Always allow the motor to stop before moving to the next set of pins or spaces. (See "Timer Program" instructions).
4. Position valve to backwash and check to make sure that drain line flow remains steady for ten (10) minutes or until clear (see above).
5. Position valve to rapid rinse and check the drain line flow, run for 5 min. or until the water is clear. (Note: Rapid rinse and backwash flow rates should be the same).
6. Replace control box cover.

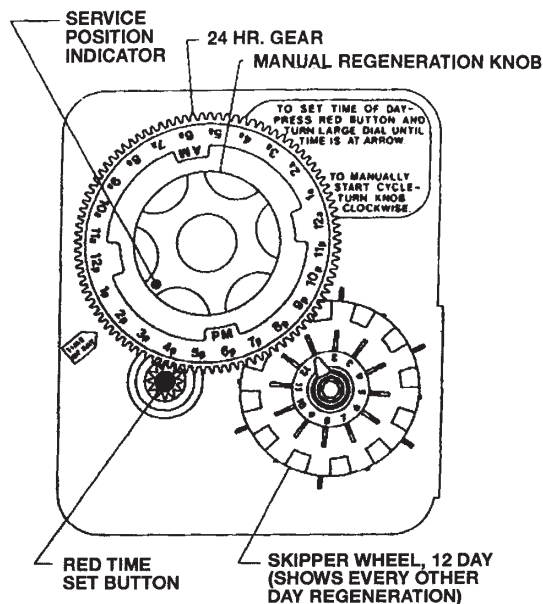

TIMER PROGRAM INSTRUCTIONS

1. *To Set Days On Which Water:* Rotate the skipper wheel until the number "1" is at the red pointer. Set the days that regeneration is to occur by sliding tabs on the skipper wheel outward to expose trip fingers. Each tab represents one day. Finger at red pointer represents tonight. Moving clockwise from the red pointer, extend or retract fingers to obtain the desired regeneration schedule. (Granular Activated Carbon every 12 days; *for Well Water Systems* - Hydroxite every day).
2. *To Set The Time Of Day:* Press and hold the red button to disengage the drive gear. Turn the large gear until the actual time of day is at the time of day pointer. Release the red button to engage the drive gear.
3. *To Manually Regenerate Your Water:* Turn the manual regeneration knob clockwise. This slight movement of the manual regeneration knob engages the program wheel and starts the regeneration program. The black center knob will make one revolution in the next three hours and stop in the position shown in the drawing. Even though it takes three hours for this center knob to complete one revolution, the regeneration cycle of your unit might be set only one-half of this time. In any event, treated water may be drawn after rinse water stops flowing from the tank drain line.
4. *To Adjust Regeneration Time:* Disconnect the power source. Locate the three screws behind the manual regeneration knob by pushing the red button in and rotating the 24-hour dial until each screw appears in the cut out portion of the manual regeneration knob. Loosen each screw slightly to release the pressure on the time plate from the 24-hour gear. Locate the regeneration time pointer on the inside of the 24-hour dial in the cut out. Turn the time plate so the desired regeneration time aligns next to the raised arrow. Push the red button in and rotate the 24-hour dial. Tighten each of the three screws. Push the red button and locate the pointer one more time to ensure the desired regeneration time is correct. Reset the time of day and restore power to the unit.

Point-of-Entry Installation Guide - Municipal Water

PLUMBING SYSTEM CLEANUP

The following procedures are guidelines only. Under no circumstances should any procedure outlined below be followed contrary to the appliance manufacture's instructions.

SOFTENER

In some cases the water softeners are to remove iron from the water. Softeners, with the addition of chlorine will remove some ferrous iron until the resin bed becomes fouled to the extent that it will lose both hardness removal capacity and the limited capacity for iron removal. This requires resin bed replacement. Use of a softener with the Point-of-Entry will cause both systems to operate at less than optimum. (99% of ECOsmarte customers discontinue the use of brine-based systems.)

HOT WATER HEATER

If the hot water heater has been exposed to both iron and hardness for a long period of time, replacement of the heater tank may be the only practical solution to prevent further stains originating from this source. After completing the installation of the Point-of-Entry System, clean the hot water heater by opening the furthest hot water faucet from the heater run the water approximately thirty minutes to purge water heater.

If after approximately thirty minutes flushing, water does not clear, terminate flushing operation. The water heater will need flushing with approximately 1/2 gallon of household bleach. Allow bleach to stand in tank for twenty to thirty minutes. Flush tank again until water is clear.

NOTE: If water does not clear in approximately ten days water heater probably should be replaced.

IMPORTANT: Use medium setting on water heater when available.

DISHWASHER

The dishwasher will normally clean itself within a few days. Consult owner's handbook and follow manufacturer's instructions. After installation of Point-of-Entry, use vinegar as your rinse agent, medium heat or air-dry instead of high heat. The high heat setting is your largest residential amperage draw and is not cost effective or energy efficient, similar to the high settings on most water heaters.

TOILET FLUSH TANKS

Prior to installation pour 4 to 6 ounces of toilet bowl cleaner into flush tanks and bowls and let stand. When

installation is completed, flush toilets several times with iron-free water. If iron deposits or stains remain, repeat procedure until clear. The system will prevent recurrence.

IRON

Iron concentration as low as 0.3 ppm will cause staining. Your Point-of-Entry System is capable of filtering out the three main types of iron found in water supplies: soluble iron (also known as "clearwater" or ferrous iron), precipitated iron (also known as "red water" or ferric iron), and bacterial iron (also known as iron bacteria). Special care must be taken when we select a filter model if your water has a combination of high iron, very low pH and/or manganese levels above 0.2 ppm. ECOsmarte Well Water systems address these conditions.

MANGANESE

Manganese can cause more staining problems than iron and removal is difficult, even for the Point-of-Entry System. As little as 0.05 ppm of manganese can produce brown or black staining. The ability of the filter to remove manganese depends on its concentration, the pH of the water, and other mineral combinations.

TANNINS (HUMMIC ACID)

Tannins (a hummic acid) are the result of various forms of decaying vegetation. Tannins can cause in the operation of the Point-of-Entry filter by a sticky coating on the media, thus rendering it incapable of filtering. Generally with tannin concentrations of 0.5 ppm or less, frequent backwashing will prevent the sticky coating from forming. Your Point-of-Entry representative before installing the system will need specific information; the type and level of tannins in the water and other contaminants that may need to be addressed. Cleaning of electrodes is required every three months when tannins are present.

HYDROGEN SULFIDE (H₂S)

Hydrogen Sulfide (often referred to as "sulfur"), is easily detectable by its objectionable "rotten egg" odor. Sulfur corrodes iron, brass, copper, and silver. The Point-of-Entry is capable of removing sulfur in concentrations of up to 2 or 3 ppm, and sometimes as high as 5 ppm. Whenever hydrogen sulfide is present, backwashing must be performed at more frequent intervals, and the pumping system must include a retention tank to allow time for the oxygen to react with the hydrogen sulfide. Some cities deliver this odor only during certain seasons. You may backwash every day until source water clears.

Point-of-Entry Installation Guide - Municipal Water

pH

Water with a pH of 7.0 is neutral. pH below 7.0 is acidic. Acidic water (pH less than 7.0) is corrosive to pipes, appliances, etc. A pH of 7.0 or higher facilitates iron removal, which is why the filter is designed to increase the pH slightly (.1 to .2).

TROUBLESHOOTING GUIDE

Your Point-of-Entry will give you years and years of quality water and trouble-free service. The electrodes and filter material need to be replaced about every 5 to 8 years, depending on your Point-of-Entry model. The chart below will help you know when this should be done. In addition, the chart will help you handle other infrequent problems.

Important: If you think you have a problem, please check these items first before calling for service.

- Is your Point-of-Entry plugged in?
- Has water been flowing through the system and not bypassing it? Check bypass valves.
- Is backwash drain line crimped or plugged in?
- Has system been regularly backwashing? Check the backwash pins.
- Is “time of day” correct on backwash timer?

1. No Lights on Control Box:

Possible Causes:

- System is unplugged, or turned off.
- Well water system: light only turns on when pump runs
- Electrodes need replacement.
- Box defective due to power surge.

What to Do:

- Plug ‘it back in, turn switch to “on” position.
- Make’ sure wires are connected.
- See if a light turns on when pump starts up.
- Confirm outlet is good.
- Call for replacements.

2. Lights Circle Constantly:

Possible Causes:

- Flow switch is stuck, or plumbed backwards.

What to Do:

- Pull plastic pin on side of flow switch or, if installed, use quick disconnect to blow clear.
- Disconnect copper electrode lead wires until fixed to avoid build-up of copper. Your titanium electrode will be free, additional dissolved oxygen in the water will do no harm.

3. Loss of Water Pressure or Flow:

Possible Causes:

- City water system lost pressure.
- Pump out (for well water).
- Bypass valve partially closed; home valves not fully open. Open all valves completely, then turn back one-quarter turn to prevent future sticking.
- Filter tank is fouled because backwashing hasn’t occurred, drain line is plugged or pump output is too low.

What To Do:

- Check to see if city is problem.
- Check pump and pressure tank.
- Check valve positions on unit and in home.
- Booster pump or larger pip’rag needed if regular occurrences. May need larger Point-of-Entry tank.
- Make sure tank has been backwashing. Manually backwash system.

4. Water is coming out the backwash drain at the wrong time:

Possible Causes:

- Power outage has reset clock on automatic system.
- Installer plugged system into outlet that only has intermittent power.

What to do:

- Reset to proper time.

5. Black Specks Seen in Water, Second Week

Possible Causes:

- System has not been backwashed adequately.
- Water going through Point-of-Entry tank in the wrong direction.

What to do: (See Start-up)

- Run system through manual backwash. And run cold water from faucet close to Point-of-Entry until clear.
- Call installer to correct.
- Drain and flush water heater.

6. White Powder On Glassware In Dishwasher Or On Shower Glass Doors.

Possible Causes:

- This problem is old scale or calcium in water.

What to Do:

- Try using vinegar as dishwasher rinsing agent. Try other types of soaps if problem lasts more than a month or so.
- Non-chlorine cleaners such as Lime-Away will produce best results.

7. Chunks Of White Scale In Faucet Aerators.

Possible Causes:

- System installed in houses with existing scale.

What To Do:

- This problem shows Point-of-Entry is working to eliminate scale. Take off aerators as needed to clear.

8. Soap In Clothes Or Residue In Hair.

Possible Causes:

- Too much soap being used.

What To Do:

- Reduce soap used

9. Orange-Brown Stain In Laundered Clothes or Rotten Egg Odor Is Noticed:

Possible Causes:

- Water is bypassing your tank,
- Electrodes not getting power.
- Tank is fouled and is not backwashing enough, improper backwashing.
- Water source quality has changed.
- Well system: Pressure tank undersized.

What To Do:

- Check valve positions to make sure water is flowing through tank.
- Check to see that system has power. Check drain line for plugs. Run system through a manual backwash cycle. Good flow to drain? If not, open tank and clean head.
- Contact us to see if you may need a larger system that matches your increased water needs.
- Call us to retest water. New media or bigger tank needed.
- Call us to make sure system is working and is the proper size for your needs.

10. Fishy Smells, Chlorine Or Other Odor

Possible Causes:

- Water is bypassing your tank.
- You are using water at a faster rate than capacity.

What To Do:

- Check valve positions to make sure water is flowing through tank.
- Contact us to see if you need larger tank.

11. Green Water build-up in Toilet or Bath:

Possible Causes:

- Flow switch is stuck, putting constant power to the copper electrode.
- Power is constant to electrodes due to box failure.
- pH of water is below 6.4 (well water).

What To Do:

- Clean flow switch.
- Call dealer for replacement box.
- Consider pH-up tank.

Contact us if you discover other problems that we haven't covered here. Most problems tend to occur right after installation. Once solved, you can expect maintenance free service for a long time.

RESIDENTIAL PREVENTATIVE MAINTENANCE SCHEDULE

1. Electrode cleaning: **once per year (every 6-months in AZ, TX, and bad water areas).**
2. Electrode replacement: every 5-8 years.
3. Filter replacement (threaded tank only): every 5-8 yrs.

You will need to replace the copper electrodes only; the titanium should never corrode. However both electrodes should be cleaned annually to insure system performance.

The electrodes can be cleaned periodically by removing the entire chamber and Soaking it in a water/muriatic acid solution (5:1). To replace the copper electrodes, see the Copper Electrode Replacement Instructions sheet.

KEEP INSTRUCTIONS AND TROUBLESHOOTING MANUAL IN A SAFE PLACE FOR FUTURE REFERENCE.



PLANET FRIENDLY™

1-800-466-7946

www.ecosmarte.com

OUR PRODUCT GROUP

- ☐ 100% Chemical-Free Spa System
- ☐ 100% Chlorine-Free Pool System
- ☐ Well Water Point-of-Entry
- ☐ Municipal Point-of-Entry


INSTALLATION AND MAINTENANCE OF MODEL 1800 FLOW SWITCH

Install to proper IN-OUT directions and calibration attitude. The 1800 model flow switch operates only when installed vertically as shown on the diagram at right. Configure so that the lead wires are pointing up. Use standard medium bodied PVC solvent cement, (customer supplied). Follow assembly instructions on label. Do not use excess cement. Keep unit free of all thread sealing compounds, etc.

To clean the flow switch, disassemble by pushing down on bonnet and pulling out locking wire (white plastic). Then, slowly pull up bonnet using care not to damage "O" ring in locking wire hole. Remove retaining ring and wipe down as necessary. **NOTE: Water must be shut-off at the SHUT-OFF VALVES. See Front-Page Diagram**


UNDERSTANDING YOUR CONTROL VALVE

When changing your Backwash, Slow Rinse and Rapid Rinse Times, adhere to the following guidelines. Remember a complete overview of the instructions is to be found on the inside of the valve cover-plate. ECOsmarte wishes to clarify here additional features and information for the ECOsmarte customer who does not use brine tanks. The brass plug in the back of the valve defeats the salt regeneration cycle.

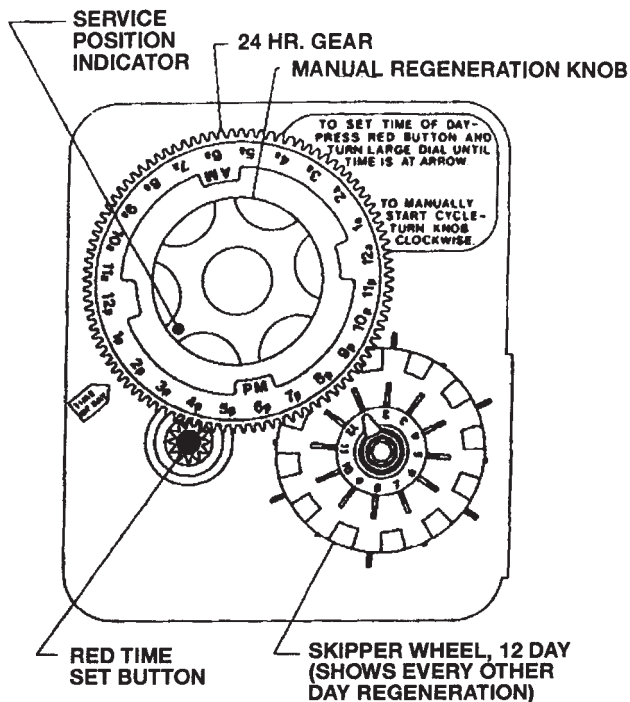


2510 Control Head

****MUST INSTALL VERTICAL****

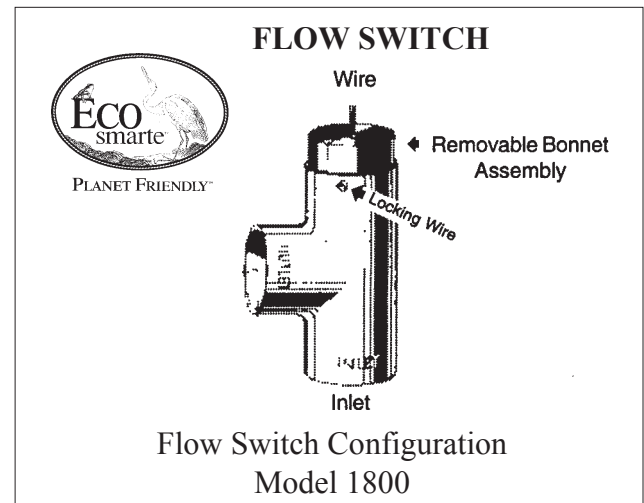

CONNECTING LEAD WIRES TO CHAMBER

The thicker of the two wires coming from the ECOsmarte Controller will get connected to the Copper / Titanium Chamber installed in your water line. That wire will contain one Black, and one Red wire with female ends already attached. The RED and the BLACK wires go to the male connectors on either side of the chamber on the COPPER end. Included with the system, is a Clear Jumper Wire with female ends. One end of this Clear Jumper wire attaches to either side of the chamber on the Copper end. The other end of the Clear Wire, Jumpers up to connect to either side of the Titanium end of the chamber. Now, all FOUR electrode plates will receive power when water is turned on in the house. *SEE DIAGRAM BELOW.*

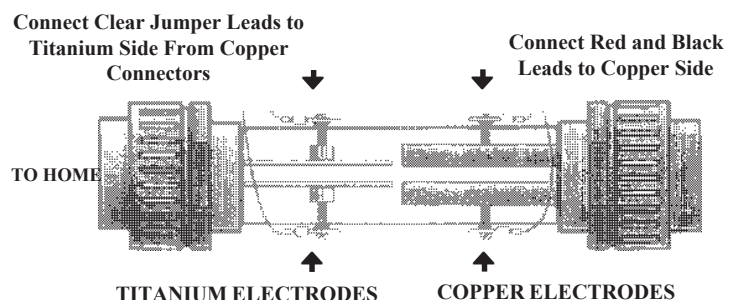

LEAD WIRE CONFIGURATION

Red and Black Leads ► Copper Connectors

Clear Jumper Wire ► To Titanium Connectors
From Copper Connectors

ECOsmarte Point-of-Entry Factory Warranties

LIMITED FIVE-YEAR WARRANTY

ECOsmarte warrants to the original owner that the entire water system (including tanks, electronics, flow switch and media) is free from defect in material and workmanship under normal use, service and conditions. All parts are F.O.B. factory.

The labor charges incidental to the repair and/or replacement of parts, tanks, or water conditioning units other than factory repairs is expressly **excluded** from this warranty. The filter media is also expressly **excluded** from this warranty **IF the electrode chamber(s) have not been maintained, or the Wellmate retention tank has not been "Blown Down" according to manufacturer's requirements.** See *Warranty Repair* section below for repair procedures.

LIMITED LIFETIME WARRANTY

ECOsmarte warrants to the original owner that the pressure vessel (i.e., tanks only) is free from defect in material and workmanship under normal use, service and conditions.

To the original owner at the original installation site, the pressure vessel is warranted not to leak, burst, or fail in any way, subject to the following conditions:

- (1) Installation is made according to manufacturer's recommendations and local codes, and
- (2) Water pressure does not exceed 100 PSI or water temperature not higher than 100° F, and
- (3) That failure has not resulted from misuse, alteration, freezing, or act of God, and
- (4) A bypass valve has been installed (which comes with the water valve).

If failure should occur, the manufacturer will replace (labor and freight excluded) or at its option repair any part or parts that to its satisfaction proves defective. In no event shall manufacturer's liability exceed the original purchase price.

All warranty coverage terminates if you sell or otherwise transfer the equipment.

WARRANTY REPAIR PROCEDURE

In order to be eligible for service under this warranty you **MUST** return the warranty registration card attached below within 60 days of purchasing the ECOsmarte product. If something goes wrong with your ECOsmarte product, call 1(800)466-7946 with a brief description of the problem or write:

**ECOsmarte Planet Friendly, Inc.
1600 East 78th St.
Richfield, MN 55423**

We will problem solve your system and contact you within 72 hours to give the results of our analysis and an estimate of the labor charges required to fix the System. If you authorize repairs, we will either arrange for on-site service or instruct you to send the product to the factory. You must pay any labor charges upon receipt of the repaired System. If you inform us that you wish us to provide necessary parts to you but you wish to have repairs performed elsewhere, we send replacement parts to you within 72 hours. There is no charge for problem solving. A minimum charge of \$25 is assessed to any electronic box sent to the factory and no problem is identified (The box has a 99% quality chart).

NO OTHER WARRANTY EXPRESSED OR IMPLIED, INCLUDING MERCHANTABILITY, APPLIES

to the equipment, nor is any person or company authorized to assume any other warranty. ECOsmarte Planet Friendly, Inc., does not assume any responsibility for any consequential damages occasioned by the equipment, or inconvenience or interruption in operation. This warranty gives you specific legal rights, and you may also have other rights which vary from state to state. Please register your warranty with the form included in this manual.

FREE ELECTRODE OFFER: \$90 Value

There are two ways in which ECOsmarte will send you a free set of replacement copper electrodes for your city water system. Take advantage of one of these, and your water treatment system will operate 10 to 15 years without needing to re-order copper electrodes.

- 1) Refer one customer, who purchases an ECOsmarte Point-Of-Entry water treatment system (municipal or well) and you qualify for a free set of replacement copper electrodes (\$95 Value).

OR

- 2) Send us a two or three paragraph letter telling us what you like about your water or the changes you noticed in your home water when using the ECOsmarte Point-Of-Entry water treatment system. Send this letter in with your warranty card below, and we will post it shortly thereafter on our "testimonials" section of our web page, and you will qualify for a free set of replacement copper electrodes (\$75 Value).

The Friendliest Products on the Planet



ECOsmarte Point-of-Entry Warranty Registration

Date Received: _____

Name: _____

Street Address: _____

City: _____

State / Zip: _____

Phone Number: _____

Return this card within 60 days to register your ECOsmarte Point-of-Entry System. Timely registration will ensure a prompt warranty response in the event a problem occurs. Carefully read the Warranty descriptions on this document. The same warranty information is contained within your Owner's Manual.

FREE ELECTRODE KIT OFFER! To receive your free copper electrode kit from the ECOsmarte factory, just send this registration card along with a paragraph describing why you enjoy your ECOsmarte Water.

MAIL TO: ECOsmarte Planet Friendly
730 W. 78th Street
Richfield, MN 55423

**Product
Purchased:**

Municipal
System

☐

Well Water
System

☐

Commercial
Point-of-Entry
System

☐

LIMITED FIVE-YEAR WARRANTY

ECOsmarte warrants to the original owner that the entire water system (including tanks, electronics, flow switch and media) is free from defect in material and workmanship under normal use, service and conditions. All parts are F.O.B. factory.

The labor charges incidental to the repair and/or replacement of parts, tanks, or water conditioning units other than factory repairs is expressly **excluded** from this warranty. The filter media is also expressly **excluded** from this warranty **IF** the electrode chamber(s) have not been maintained according to manufacturer's requirements. See **Warranty Repair** section below for repair procedures.

LIMITED LIFETIME WARRANTY

ECOsmarte warrants to the original owner that the pressure vessel (i.e., tanks only) is free from defect in material and workmanship under normal use, service and conditions.

To the original owner at the original installation site, the pressure vessel is warranted not to leak, burst, or fail in any way, subject to the following conditions:

- (1) Installation is made according to manufacturer's recommendations and local codes, and
- (2) Water pressure does not exceed 100 PSI or water temperature not higher than 100° F, and
- (3) That failure has not resulted from misuse, alteration, freezing, or act of God, and
- (4) A bypass valve has been installed (which comes with the water valve).

If failure should occur, the manufacturer will replace (labor and freight excluded) or at its option repair any part or parts that to its satisfaction proves defective. In no event shall manufacturer's liability exceed the original purchase price.

All warranty coverage terminates if you sell or otherwise transfer the equipment.

WARRANTY REPAIR PROCEDURE

In order to be eligible for service under this warranty you **MUST** return the warranty registration card attached below within 60 days of purchasing the ECOsmarte product. If something goes wrong with your ECOsmarte product, call 1(800)466-7946 with a brief description of the problem or write:

ECOsmarte Planet Friendly, Inc.
730 W. 78th St.
Richfield, MN 55423

We will problem solve your system and contact you within 72 hours to give the results of our analysis and an estimate of the labor charges required to fix the System. If you authorize repairs, we will either arrange for on-site service or instruct you to send the product to the factory. You must pay any labor charges upon receipt of the repaired System. If you inform us that you wish us to provide necessary parts to you but you wish to have repairs performed elsewhere, we send replacement parts to you within 72 hours. There is no charge for problem solving.

NO OTHER WARRANTY EXPRESSED OR IMPLIED, INCLUDING MERCHANTABILITY, APPLIES to the equipment, nor is any person or company authorized to assume any other warranty. ECOsmarte Planet Friendly, Inc., does not assume any responsibility for any consequential damages occasioned by the equipment, or inconvenience or interruption in operation.

This warranty gives you specific legal rights, and you may also have other rights which vary from state to state.

Please register your warranty with the form included in this manual.




PLANET FRIENDLY®

100% CHEMICAL-FREE SPA OR WATERFALL SYSTEM



Priced from
\$999

Enjoy the same premium water in your spa or **waterfall** that you have in your entire house. The **ECOsarte Spa** and **Waterfall System** comes configured to your needs. We offer products to run crystal clear, chemical-free water, a dual electrode, copper-titanium system. Even large, heavily used or outdoor spas (350 - 10,000 gallons) or ponds with fish will enjoy clear water without chemicals. You will find the dual electrode chamber is simple to install and it comes with a 60-day, money-back guarantee. Your spa will not require sanitation chemicals again, and you will go right from the water to your pajamas. Birds will visit you pond or waterfall. Copper ions destroy bacteria and algae while, for large spas the titanium oxidizes inert organics, and eliminates ammonia in fishponds.



Turbo: Dual Electrode 1 1/2"
(Split Chambers available)
at additional cost


TESTIMONIALS AT
www.ecosmarte.com

100% CHLORINE-FREE POOL SYSTEM



Priced from
\$999

The **ECOsarte 100% Chlorine-Free Pool System** offers the swimming pool owner something never before available: simple pool maintenance combined with the finest swimming water in the pool industry. The standard **Above-Ground Pool System** (up to 10,000 gallons) generates copper ions which destroy bacteria and algae. The titanium electrode oxidizes inert organic matter; a non-chemical, oxygen shock is delivered to your pool each time the pump is run. The **Turbo Pool System** (10,001 to 50,000 gallons) reduces your electric bill as your pump will only need to be run 4 to 8 hours per day. In addition it comes with a 60-day, money-back guarantee, and a 5-year factory warranty. Installation is simple. You cut out 11" of your above-ground PVC pipe and insert the chamber with our quick-change Unions. You will use your pool more, and wish you had purchased the **100% Chlorine-Free Pool System** long ago!



Turbo: Dual Electrode 1 1/2"
(Split Chambers available)
at additional cost

(Automated System Available For up to 750,000 gallons)

1-800-ION SWIM

The Best Non-Salt, Non-Chemical Water Technology
or look us up on the web at
www.ecosmarte.com



ECOsmarte Point-of-Entry Post-Installation Checklist

PLANET FRIENDLY™

- ☐ 1) Has unit(s) backwash run clean?
- ☐ 2) Has faucet nearest the filters run clean?
- ☐ 3) Have other faucets been opened and has trapped air or carbon passed clear?
- ☐ 4) Do control box lights circle when water flows? Do the lights stop circling when the water stops flowing?
- ☐ 5) Does D/C voltage exist between 5V and 19V on both copper and titanium electrodes?
- ☐ 6) Does polarity reverse on voltage (indicated by lights reversing)?
- ☐ 7) Does voltage stop when lights stop circling on the Control Box?
- ☐ 8) Does copper ppm measure between 0.1 and 0.5 ppm?
- ☐ 9) Has backwash line been properly secured?

TIPS FOR EASIEST INSTALL & BEST PERFORMANCE

- A) Soak Granular Activated Carbon and/or Hydroxite filters 24 hours before putting in final service. This can be done before tank is brought to site, or the night before installation. Unit can be left in bypass the first night after installation.
- B) Water with Total Dissolved Solids **BELOW** 500 ppm should operate in "**High**" mode; water with Total Dissolved Solids **ABOVE** 500 ppm should operate in "**Low**" mode.
- C) Electrode Cleaning Schedule: Well Water Systems - 60 days; Municipal Water Systems - visually inspected at 180 days and cleaned at least annually. Cleaning should be done using three-parts water and one-part muriatic acid (3:1) in a 5-gallon bucket for 15 minutes.